



F1-80-300 Series
Standard Response Sprinklers
K-factor 8.0 (115)

Features

- Standard coverage standard-response sprinklers
- 300 psi (20.7 bar) rated
- Upright and pendent deflectors
- Low profile, compact design
- Available in a wide variety of finishes

Product Description

Reliable Model F1-80-300 series sprinklers are 300 psi (20.7 bar) rated, standard-response standard spray automatic fire sprinklers utilizing a 5.0 mm glass bulb thermal element.

Pendent sprinklers may be installed exposed or surface mounted using escutcheons such as the Reliable Models B, C, or HB (reference Technical Bulletin 204). When installed recessed, the Model F1-80-300 series sprinklers are specifically listed with and may only be installed with Reliable listed recessed escutcheons. Refer to the technical information on the following pages for specific listings for recessed installations and refer to Figure 3 for dimensional information.

Table A provides a summary of the approvals and availability of specific Model F1 series sprinkler configurations. Additional technical information for each sprinkler model is provided on the following pages.

Important! Reliable fire sprinklers must be handled, stored, and installed in accordance with the guidelines in Caution Sheet 310 and this bulletin. Failure to follow these instructions may result in unintended operation or nonoperation of the fire protection system.



Model F1-80-300 Upright



Model F1-80-300 Pendent

Note: Not all versions of the product are shown.

F1-80-300 Series Sprinkler Summary					Table A
Sprinkler Model	K-Factor gpm/psi ^{1/2} (lpm/bar ^{1/2})	Orientation	Listings & Approvals	Max. Working Pressure psi (bar)	Sprinkler Identification Number (SIN)
F1-80-300	8.0 (115)	Upright	cULus	300 (20.7)	RA7622
		Pendent			RA7612

Model F1-80-300 Upright Sprinkler

SIN RA7622

Technical Specifications

Style: Upright

Threads: 3/4" NPT or ISO 7-R3/4

Nominal K-Factor: 8.0 (115)

Max. Working Pressure: 300 psi (20.7 bar)

Material Specifications

Thermal Sensor: 5 mm Glass Bulb

Sprinkler Frame: Brass Alloy

Cap: Bronze Alloy

Sealing Washer: Nickel with PTFE

Load Screw: Copper Alloy

Deflector: Brass Alloy

Sprinkler Finishes

(See Table B)

Sensitivity

Standard response

Temperature Ratings

135°F (57°C)

155°F (68°C)

175°F (79°C)

200°F (93°C)

286°F (141°C)

360°F (182°C)

Sprinkler Wrenches

Model W2



Listings and Approvals

cULus



Model F1-80-300 Upright Sprinkler Components and Dimensions

Figure 1

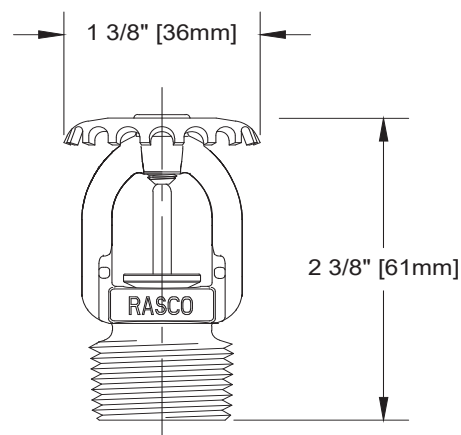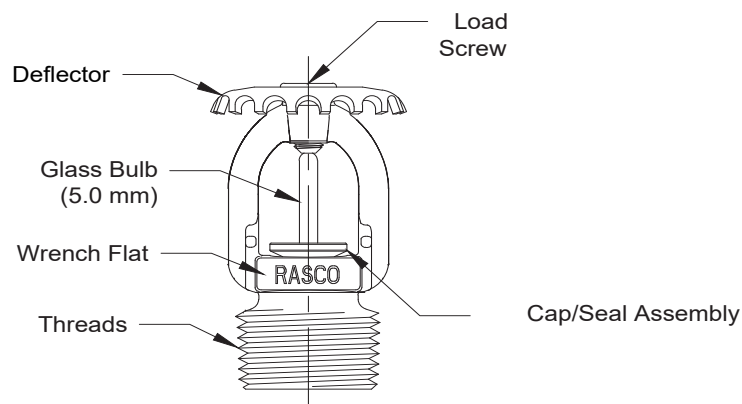

076UPR

Model F1-80-300 Pendent Sprinkler

SIN RA7612

Technical Specifications

Style:

Pendent
Recessed Pendent

Threads: 3/4" NPT or ISO 7-R3/4

Nominal K-Factor: 8.0 (115)

Max. Working Pressure: 300 psi (20.7 bar)

Temperature Ratings ⁽¹⁾

135°F (57°C)

155°F (68°C)

175°F (79°C)

200°F (93°C)

286°F (141°C)

360°F (182°C)

Material Specifications

Thermal Sensor: 5 mm Glass Bulb

Sprinkler Frame: Brass Alloy

Cap: Bronze Alloy

Sealing Washer: Nickel with PTFE

Load Screw: Copper Alloy

Deflector: Brass Alloy

Recessed Escutcheons

Model F1

Model F2

Sprinkler Wrenches

Model W2 (non-recessed)

Model W1 (recessed)

Listings and Approvals

cULus Listed

Sprinkler Finishes

(See Table B)

Sensitivity

Standard response




Notes:


1. 286°F (141°C) and higher temperature rated sprinkler not listed for recessed use.

Model F1-80-300 Pendent Sprinkler Components and Dimensions

Figure 2

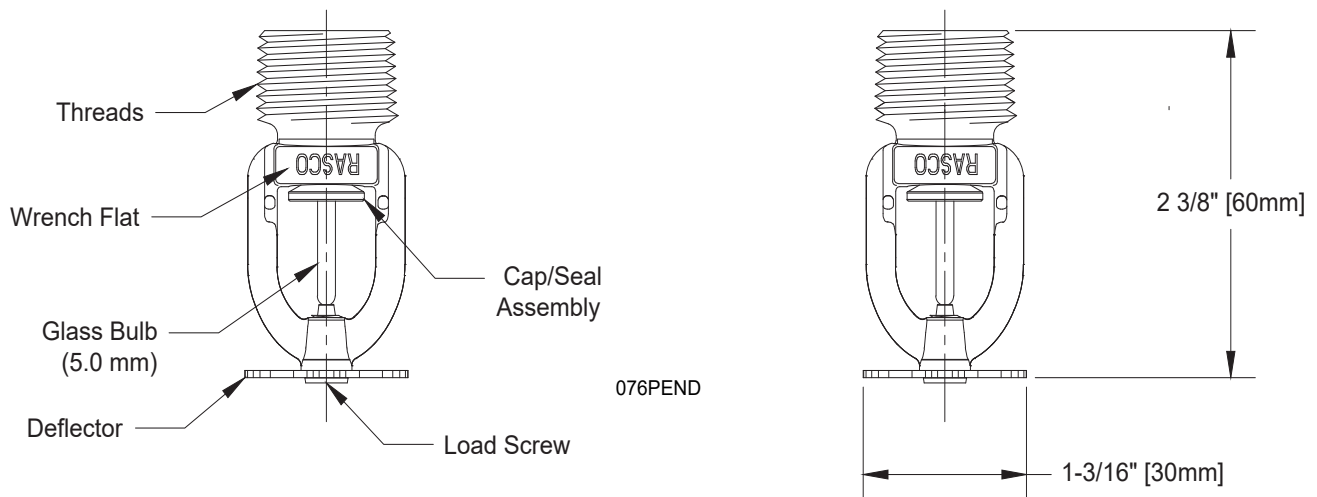

Note: Please refer to Figure 3 for recessed installation.

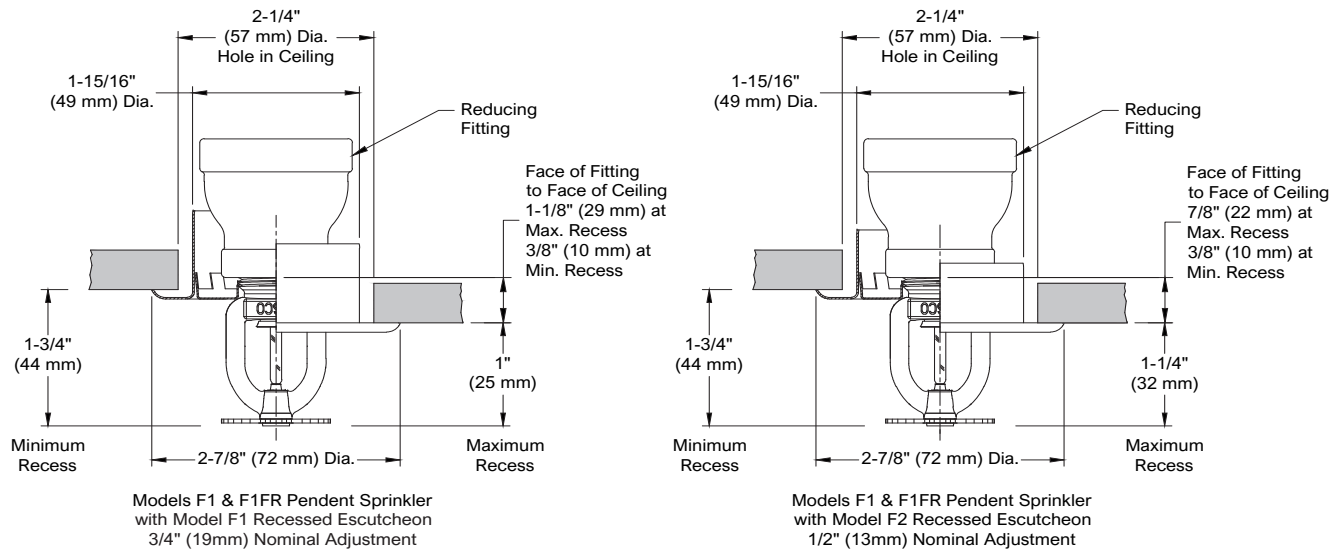

F1_REC_PEND_NO FP



Wrenches



Model W2 (upright, surface mount, exposed)



Model W1 (recessed)

Finishes⁽¹⁾

Table B

Standard Finishes		Special Application Finishes	
Sprinkler	F1 Escutcheon	Sprinkler	F1 Escutcheon
Bronze	Brass	Electroless Nickel PTFE ⁽²⁾	Bright Brass
Chrome Plated	Chrome Plated	Bright Brass ⁽³⁾	Satin Chrome
White Polyester ⁽²⁾	White Polyester	Satin Chrome	Custom Color Polyester
		Custom Color Polyester ⁽²⁾	
		Lead ⁽²⁾	
		Wax ⁽²⁾⁽⁴⁾	
		Wax over Lead ⁽²⁾⁽⁴⁾	

Notes:

1. Paint or any other coating applied over the factory finish will void all approvals and warranties.
2. cULus Listed as corrosion resistant.
3. For 200°F (93°C) maximum temperature rated sprinklers only.
4. Clear wax used on ordinary temperature rated sprinklers; brown wax used on intermediate temperature rated sprinklers. Brown wax may be used on high temperature rated sprinklers where the ambient temperature does not exceed 150°F (66°C).

Installation

Model F1 Series sprinklers must be installed in accordance with NFPA13 and the requirements of all applicable authorities having jurisdiction. Model F1-80-300 Series sprinklers must be installed with the Reliable sprinkler installation wrench identified in this bulletin. Any other wrench may damage the sprinkler. A leak tight sprinkler joint can be obtained with a torque of 6 to 18 lb-ft (11 to 24 N-m). Do not tighten sprinklers over the maximum recommended installation torque. Exceeding the maximum recommended installation torque may cause leakage or impairment of the sprinkler.

Glass bulb sprinklers have orange bulb protectors or protective caps to minimize bulb damage during shipping, handling and installation. Reliable sprinkler installation wrenches are designed to install sprinklers with bulb protectors in place. Remove the bulb protector at the time when the sprinkler system is placed in service for fire protection. Removal of the bulb protector before this time may leave the bulb vulnerable to damage. Remove bulb protectors by undoing the clasp by hand. Do not use tools to remove bulb protectors.

Reliable Model F1-80-300 series sprinklers should be inspected and the sprinkler system maintained in accordance with NFPA 25, as well as the requirements of any Authorities Having Jurisdiction.

Prior to installation, sprinklers should remain in the original cartons and packaging until used. This will minimize the potential for damage to sprinklers that could cause improper operation or non-operation.

Do not clean sprinklers with soap and water, ammonia liquid or any other cleaning fluids. Remove dust by gentle vacuuming without touching the sprinkler.

Replace any sprinkler which has been painted (other than factory applied). A stock of spare sprinklers should be maintained to allow quick replacement of damaged or operated sprinklers. Failure to properly maintain sprinklers may result in inadvertent operation or non-operation during a fire event.

Guarantee

Maintenance

For the guarantee, terms, and conditions, visit www.reliablesprinkler.com.

Ordering Information

Specify the following when ordering:

Model

- F1-80-300

Deflector/Orientation

- Upright
- Pendent

Temperature Rating

- See sprinkler technical specifications

Sprinkler Finish

- See Table B

Recessed Escutcheon*

- F1
- F2

Escutcheon Finish

- See Table B

Sprinkler Wrench

- Model W2 (upright, non-recessed pendent)
- Model W1 (recessed pendent)

Note: 286°F (141°C) and higher temperature rated sprinklers are not listed to be used recessed.